


NS-120 NOISE GATE

TERMINAL CONNECTIONS

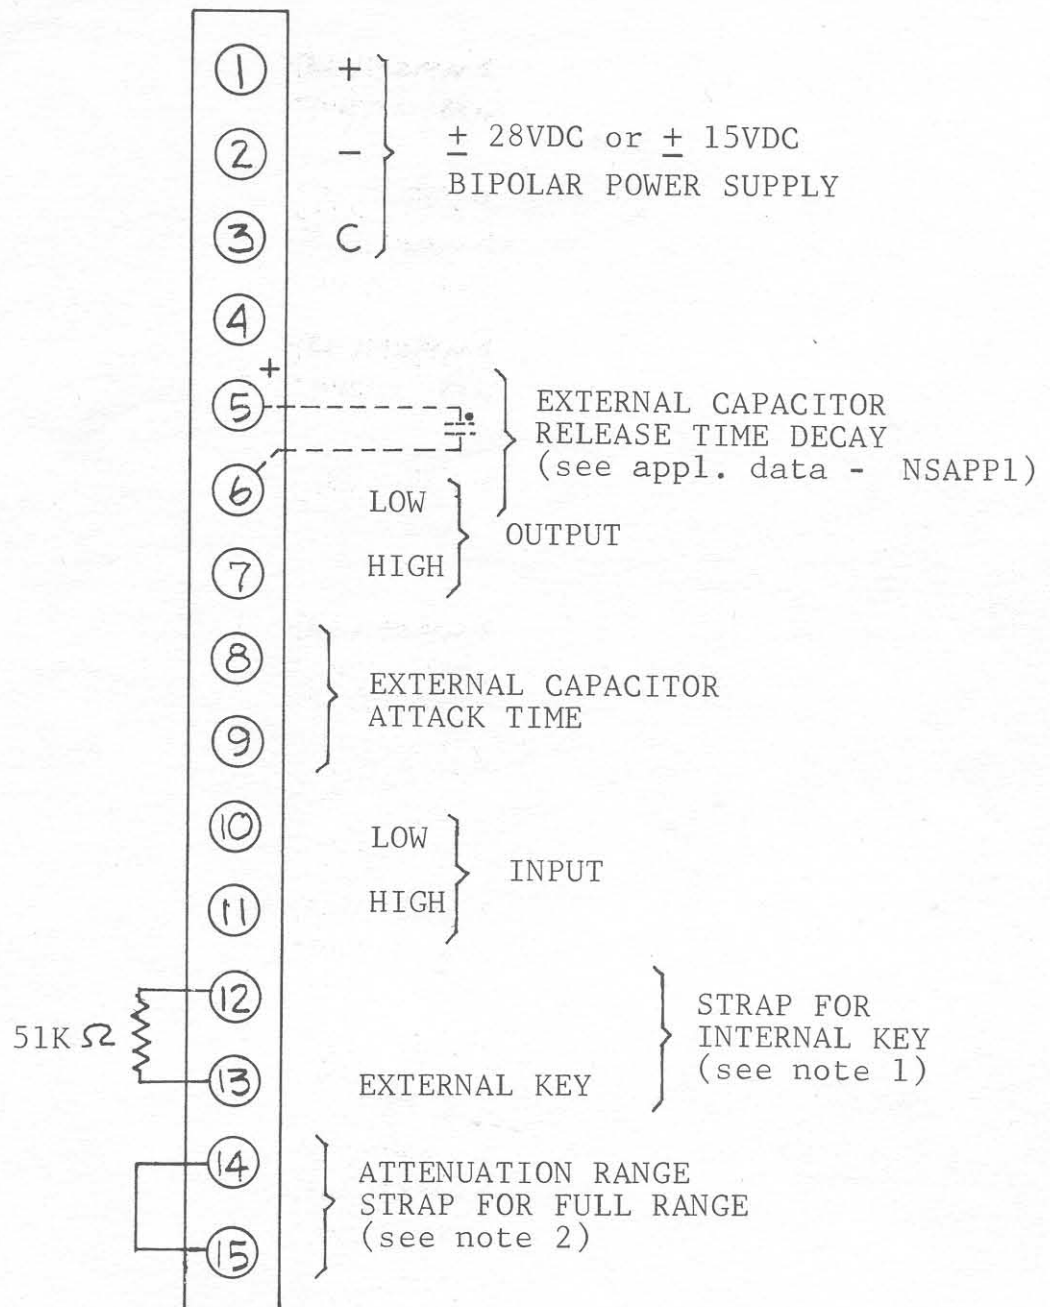

TERMINAL VIEW
OF RECEPTACLE

NOTES:

1. Strap 12-13 for self keying with -10dBm Input Level. Strap 12-13 with $51\text{K}\ \Omega$ resistor as shown for $+4\text{dBm}$ Input Level. Threshold sensitivity may be adjusted by this resistor.
2. 15dB max. attenuation range = $5.1\text{K}\ \Omega$ resistor.